



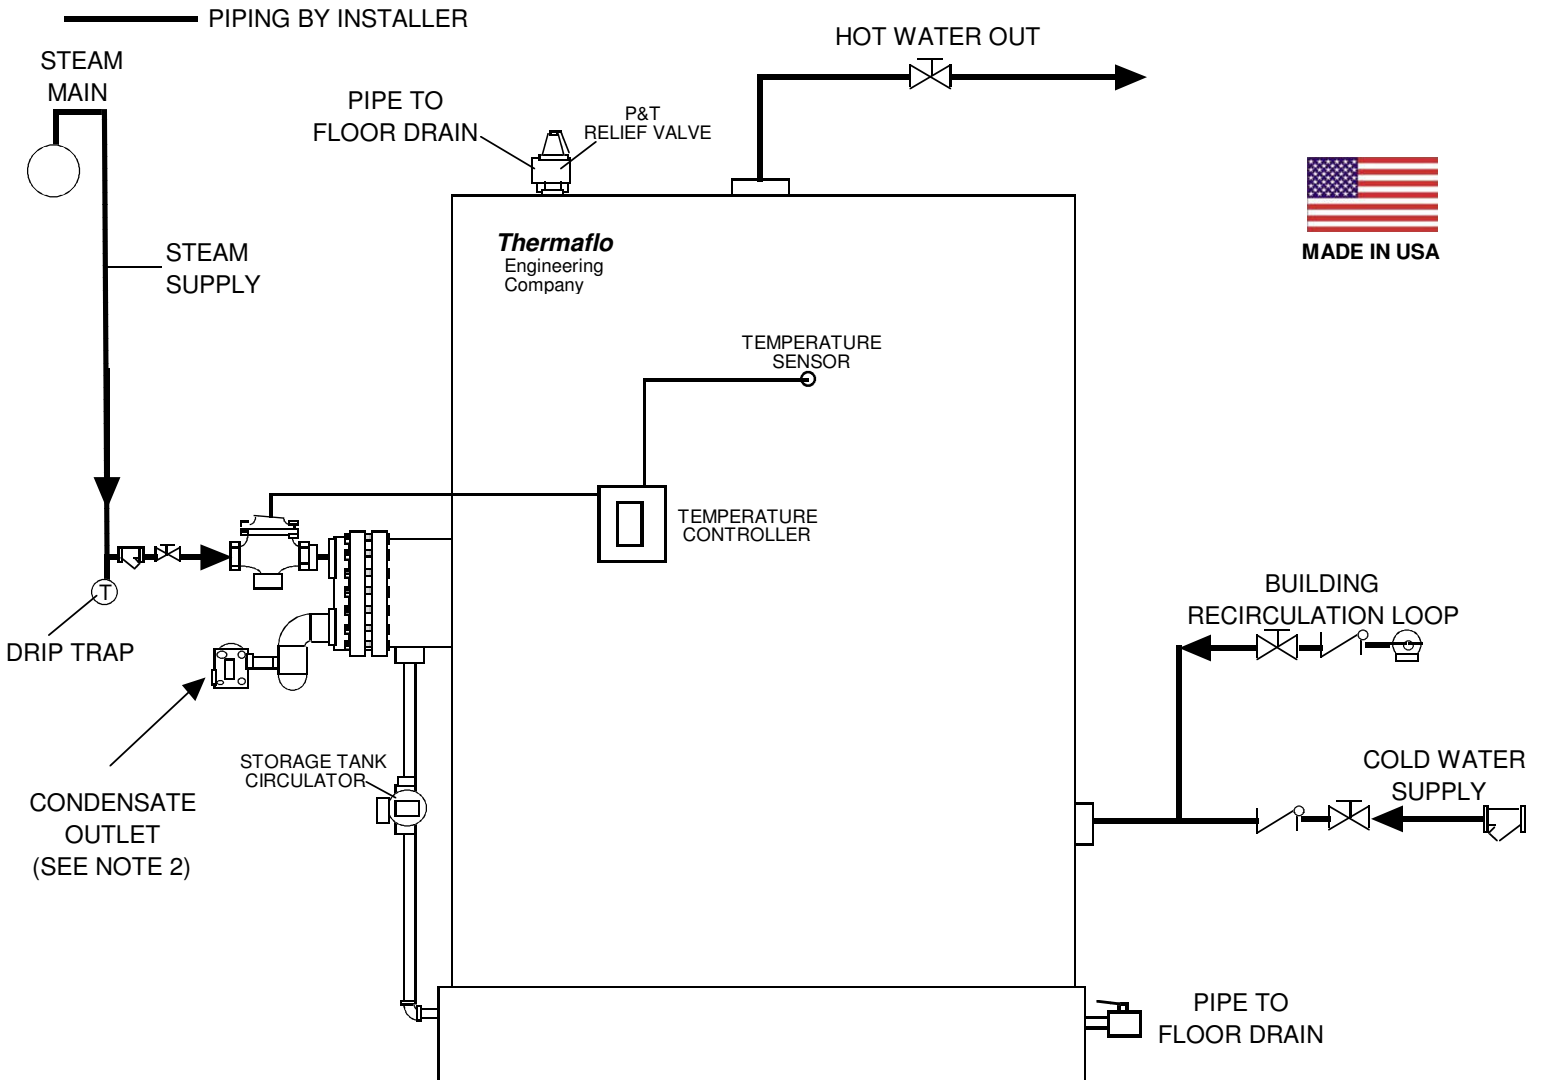
	ISOLATION VALVE
	CHECK VALVE
	CIRCULATION PUMP
	STEAM TRAP
	STRAINER

TH-750VSH Steam Fired Storage Heater Single Single Unit Hookup



Notes:

1. SUGGESTED PIPING DESIGN. DESIGNER SHOULD CONSULT LOCAL CODES TO VERIFY COMPLIANCE.
2. ALWAYS PIPE OUTLET CONDENSATE TO GRAVITY ATMOSPHERIC RETURN LINES, TO AVOID WATERHAMMER AND INTERNAL STEAM SPACE FLOODING.
3. ALWAYS PIPE SUPPLY STEAM FROM THE TOP OF THE HEADER AS SHOWN, AND INSTALL A MAIN DRIP BEFORE CONTROL VALVE INLET.
4. WHEN USING THE TH-750VSH FOR DOMESTIC LOOP SUPPLY IT IS HIGHLY RECOMMENDED TO INSTALL A THERMAFLO MASTER BLEND VALVE TO PREVENT ANY CHANCE OF SCALDING.
5. REVIEW SUBMITTAL DATA FOR CONTROL AND POWER REQUIREMENTS.